
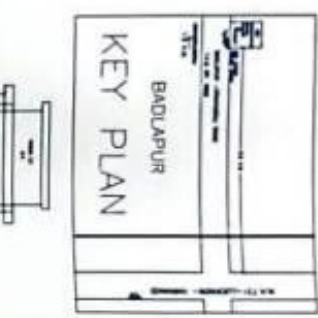


GRADE 500 FT. x 1 FT.
 1. 6-18 @ 10" ON CENTER
 2. 6-18 @ 10" ON CENTER
 3. 6-18 @ 10" ON CENTER
 4. 6-18 @ 10" ON CENTER
 5. 6-18 @ 10" ON CENTER
 6. 6-18 @ 10" ON CENTER
 7. 6-18 @ 10" ON CENTER
 8. 6-18 @ 10" ON CENTER
 9. 6-18 @ 10" ON CENTER
 10. 6-18 @ 10" ON CENTER
 11. 6-18 @ 10" ON CENTER
 12. 6-18 @ 10" ON CENTER
 13. 6-18 @ 10" ON CENTER
 14. 6-18 @ 10" ON CENTER
 15. 6-18 @ 10" ON CENTER
 16. 6-18 @ 10" ON CENTER
 17. 6-18 @ 10" ON CENTER
 18. 6-18 @ 10" ON CENTER
 19. 6-18 @ 10" ON CENTER
 20. 6-18 @ 10" ON CENTER
 21. 6-18 @ 10" ON CENTER
 22. 6-18 @ 10" ON CENTER
 23. 6-18 @ 10" ON CENTER
 24. 6-18 @ 10" ON CENTER
 25. 6-18 @ 10" ON CENTER
 26. 6-18 @ 10" ON CENTER
 27. 6-18 @ 10" ON CENTER
 28. 6-18 @ 10" ON CENTER
 29. 6-18 @ 10" ON CENTER
 30. 6-18 @ 10" ON CENTER
 31. 6-18 @ 10" ON CENTER
 32. 6-18 @ 10" ON CENTER
 33. 6-18 @ 10" ON CENTER
 34. 6-18 @ 10" ON CENTER
 35. 6-18 @ 10" ON CENTER
 36. 6-18 @ 10" ON CENTER
 37. 6-18 @ 10" ON CENTER
 38. 6-18 @ 10" ON CENTER
 39. 6-18 @ 10" ON CENTER
 40. 6-18 @ 10" ON CENTER
 41. 6-18 @ 10" ON CENTER
 42. 6-18 @ 10" ON CENTER
 43. 6-18 @ 10" ON CENTER
 44. 6-18 @ 10" ON CENTER
 45. 6-18 @ 10" ON CENTER
 46. 6-18 @ 10" ON CENTER
 47. 6-18 @ 10" ON CENTER
 48. 6-18 @ 10" ON CENTER
 49. 6-18 @ 10" ON CENTER
 50. 6-18 @ 10" ON CENTER

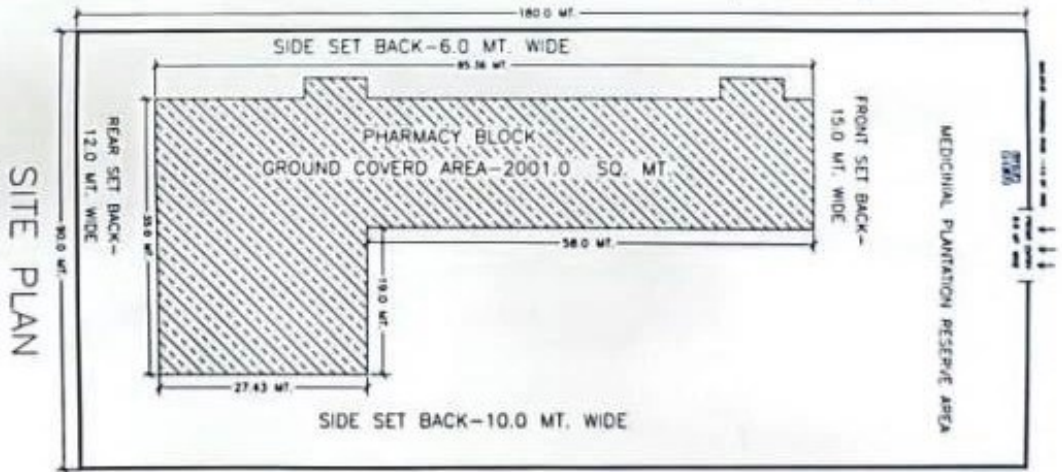

LISTING OF FREE FIGHTING SYSTEMS

ITEM DESCRIPTION	MANUFACTURER
1. FIRE ALARMS	DELTA
2. FIRE EXTINGUISHERS	DELTA
3. SMOKE DETECTORS	DELTA
4. EMERGENCY LIGHTS	DELTA
5. SMOKE EXHAUST FAN	DELTA
6. FIRE FIGHTING EQUIPMENT	DELTA
7. EMERGENCY EXIT SIGNS	DELTA
8. SMOKE EXHAUST FAN	DELTA
9. SMOKE EXHAUST FAN	DELTA
10. SMOKE EXHAUST FAN	DELTA
11. SMOKE EXHAUST FAN	DELTA
12. SMOKE EXHAUST FAN	DELTA
13. SMOKE EXHAUST FAN	DELTA
14. SMOKE EXHAUST FAN	DELTA
15. SMOKE EXHAUST FAN	DELTA
16. SMOKE EXHAUST FAN	DELTA
17. SMOKE EXHAUST FAN	DELTA
18. SMOKE EXHAUST FAN	DELTA
19. SMOKE EXHAUST FAN	DELTA
20. SMOKE EXHAUST FAN	DELTA
21. SMOKE EXHAUST FAN	DELTA
22. SMOKE EXHAUST FAN	DELTA
23. SMOKE EXHAUST FAN	DELTA
24. SMOKE EXHAUST FAN	DELTA
25. SMOKE EXHAUST FAN	DELTA
26. SMOKE EXHAUST FAN	DELTA
27. SMOKE EXHAUST FAN	DELTA
28. SMOKE EXHAUST FAN	DELTA
29. SMOKE EXHAUST FAN	DELTA
30. SMOKE EXHAUST FAN	DELTA
31. SMOKE EXHAUST FAN	DELTA
32. SMOKE EXHAUST FAN	DELTA
33. SMOKE EXHAUST FAN	DELTA
34. SMOKE EXHAUST FAN	DELTA
35. SMOKE EXHAUST FAN	DELTA
36. SMOKE EXHAUST FAN	DELTA
37. SMOKE EXHAUST FAN	DELTA
38. SMOKE EXHAUST FAN	DELTA
39. SMOKE EXHAUST FAN	DELTA
40. SMOKE EXHAUST FAN	DELTA
41. SMOKE EXHAUST FAN	DELTA
42. SMOKE EXHAUST FAN	DELTA
43. SMOKE EXHAUST FAN	DELTA
44. SMOKE EXHAUST FAN	DELTA
45. SMOKE EXHAUST FAN	DELTA
46. SMOKE EXHAUST FAN	DELTA
47. SMOKE EXHAUST FAN	DELTA
48. SMOKE EXHAUST FAN	DELTA
49. SMOKE EXHAUST FAN	DELTA
50. SMOKE EXHAUST FAN	DELTA

AREA STATEMENT

ITEM	MT
TOTAL FLOOR AREA	14190.0
TOTAL FLOOR COVERED AREA	2001.0
FIRST FLOOR COVERED AREA	2001.0
TOTAL FLOOR COVERED AREA	2001.0
OPEN FLOOR AREA	12189.0
TOTAL FLOOR AREA	14190.0
FRONT YARD ROAD	10.0

DATE: 15/05/2018
 SCALE: 1/20
 DRAWN BY: [Name]
 CHECKED BY: [Name]
 APPROVED BY: [Name]

CERTIFIED THAT THE BUILDING PLAN HAS BEEN PREPARED AS BUILDING BY S-456-2000 (2004) FIRE SAFETY NORMS AS PER N.B.C. 2018.

TOP SOIL FLOOR HEIGHT - 3.00 MT
 GROUND FLOOR - 3.00 MT
 TOTAL HEIGHT - 6.00 MT

DISTANCE FROM MAIN FIRE STATION - 1500 M
 DISTANCE FROM MEDICAL COLLEGE HOSPITAL - 400 M
 DISTANCE FROM MEDICAL COLLEGE POST OFFICE - 100 M

EXISTING EDUCATIONAL BUILDING PLAN OF
A.B.S. INTERNATIONAL SCHOOL AND COLLEGE OF PHARMACY

PHASE - 1, 2, 3, 4
 VILLAGE - SARANKA
 POST - BARANWADI
 TALUKA - BADLAPUR
 DIST - JALNATHUR

DATE OF ISSUE	DATE OF APPROVAL
15/05/2018	15/05/2018

APPROVED BY: [Signature]

DESIGNED BY: [Name]
 DRAWN BY: [Name]
 CHECKED BY: [Name]
 APPROVED BY: [Name]

SCALE: 1/20

DATE: 15/05/2018